




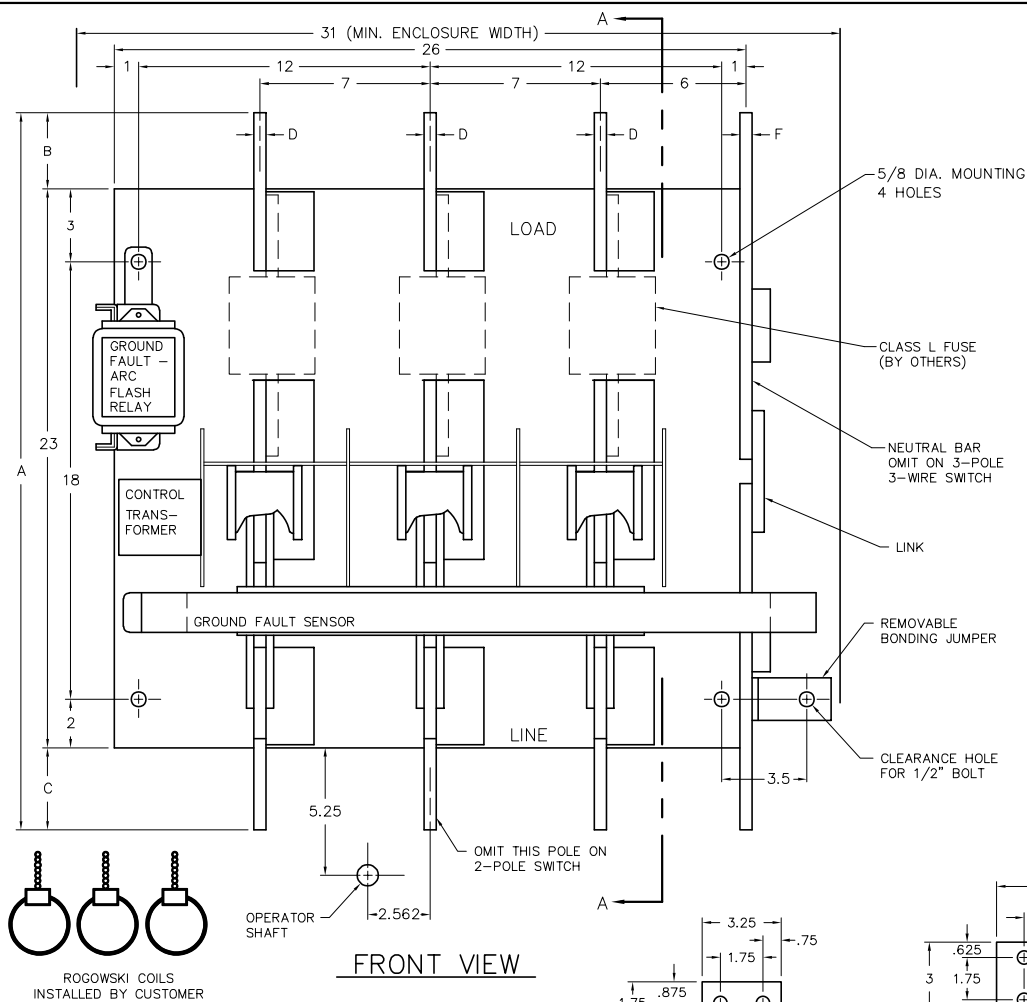

FRONT VIEW

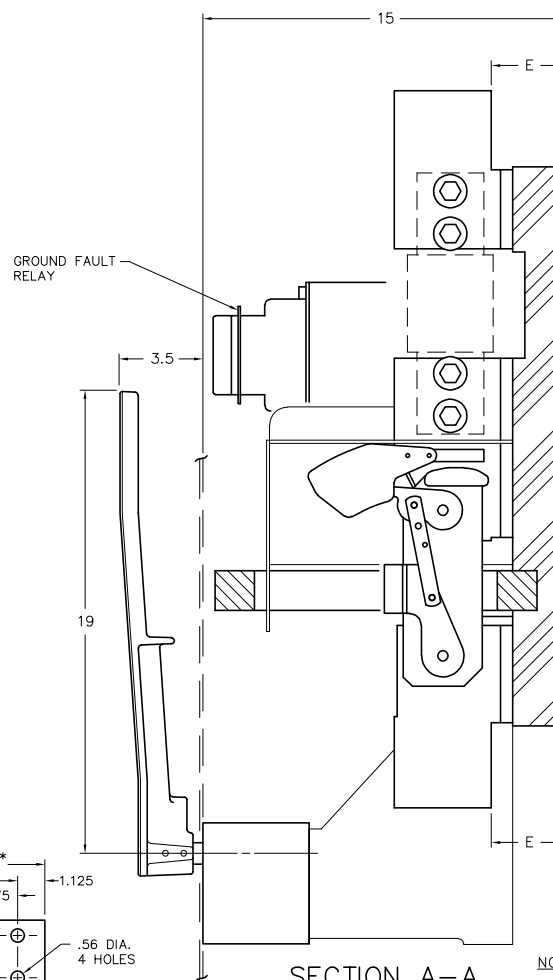

NOTE: FOR WIRING DIAGRAM OF GROUND FAULT RELAY REFER TO DWG. NO. 0-1431.

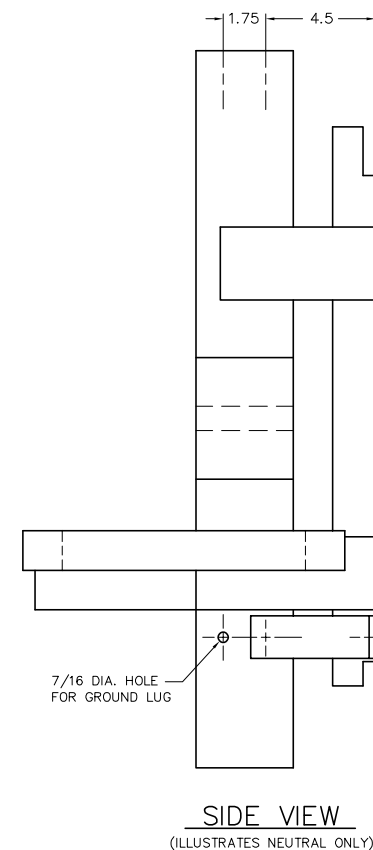

AMP	CATALOG NUMBER	NET WEIGHT	A	B	C	D	E	F	G		H
									GND.	INS.	
800	VL367XXX	179 LBS	25.75	2	1.75	.375	2.5	.25	8	4	NONE
1200	VL368XXX	186 LBS	28.5	3.25	3.25	.375	2.5	.31	10	6	NONE
1600	VL369XXX	188 LBS	28.5	3.25	3.25	.375	2.5	.375	12	6	60 SQ. IN.
2000	VL3610XXX	205 LBS	28.5	3.25	3.25	.5	2.625	.5	14	6	60 SQ. IN.
2500	VL3611XXX	220 LBS	28.5	3.25	3.25	.625	2.625	.625	16	6	80 SQ. IN.
3000	VL3612XXX	232 LBS	28.5	3.25	3.25	.75	2.625	.75	16	8	120 SQ. IN.

VENTILATION

WHEN THE SWITCH IS TOTALLY ENCLOSED, VENTILATING LOUVERS MUST BE PROVIDED YIELDING A MINIMUM OPEN AREA OF "H" SQUARE INCHES NEAR THE TOP OF THE ENCLOSURE, AND "H" SQUARE INCHES NEAR THE BOTTOM OF THE ENCLOSURE.

OPERATOR DETAILS

FOR OPERATOR DETAILS AND ALTERNATE FRONT CUT-OUTS, REFER TO DWG. NO. 0-1090A

KEY INTERLOCK

KEY INTERLOCK SPECIFICATIONS FOR SWITCHES EQUIPPED WITH KEY INTERLOCK PROVISIONS ARE:

- .375 BOLT PROJECTION WHEN WITHDRAWN
- KIRK TYPE B
- SUPERIOR TYPE B6003

RECOMMENDED FRONT CUT-OUT

SERIES VLB SWITCHES WITH INTEGRAL GROUND FAULT AND ARC FLASH		
SCALE:	APPROVED BY:	DRAWN BY AG
DATE: 04/25/025		REVISED
<i>boltswitch, inc.</i> CRYSTAL LAKE, ILLINOIS 60014		
		DRAWING NUMBER O-1291A